


## **D** Ergänzung zur Gebrauchsanweisung Notstromversorgung REG-K/640 mA Art.-Nr. 683901

Diese Angaben ersetzen die entsprechenden Texte und Bilder (Bild 6) der Gebrauchsanweisung.

**Falls Sie die Zustände der Anzeigen über einen Binäreingang auswerten wollen:  
Es darf nur der Binäreingang REG-K/4x24, Art.-Nr. 644892 in Verbindung mit Spannungsversorgung 24V, Art.-Nr. 693003 gemäß dem folgendem Anschlußbild angeschlossen werden!**

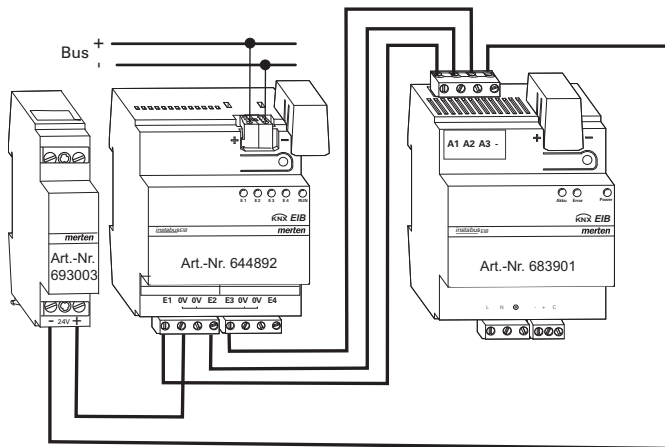


- ① **A1, A2, A3** der Notstromversorgung mit **E1, E2, E3** des Binäreingangs verbinden.
- ② „-“ des Binäreingangsanschlusses der Notstromversorgung mit „-“ der 24-Volt Spannungsversorgung verbinden.
- ③ „+“ der 24-Volt Spannungsversorgung mit „0“ des Binäreingangs verbinden.

These details replace the corresponding text and illustrations (figure 6) in the operation instruction.

## In case of recording the display status with a binary input:

You may only connect the binary input REG-K/4x24, Art.-No. 644892 in combination with power supply unit 24V, Art.-No. 693003 by the following connecting diagram.

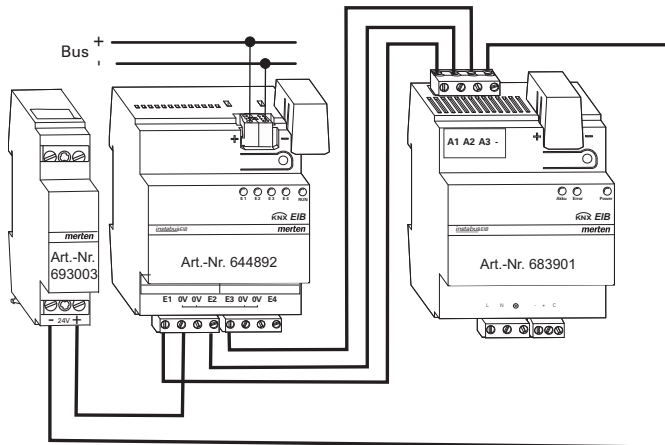

- ① Connect **A1, A2, A3** of the emergency power supply to **E1, E2, E3** of the binary input.
- ② Connect „-“ of the binary output of the emergency power supply to „-“ of the 24-Volt power supply unit.
- ③ Connect „+“ of the 24-Volt power supply unit to „0“ of the binary input.